

**HOUSES BUILT BEFORE 1975**

\*Detectors are required on each habitable level.  
 \*At least one detector shall be located at the base of each stairway leading to the next level. The detector on the bedroom level shall be centrally located on the ceiling to cover each bedroom.

*\*For each level: if WITHIN 20 ft of Kitchen or or a Bath with a shower or tub, the smoke detector shall be Photoelectric.*


*\*For each level: if the detector is OUTSIDE of 20 ft. of a Kitchen or a Bath with a shower or tub, the smoke detector shall be a dual detector (both ionization and photoelectric ) OR two separate detectors (one photoelectric and one ionization). a combination of both.*

**EVERY LEVEL MUST BE EQUIPED WITH CARBON MONOXIDE DETECTORS.** Carbon Monoxide Detectors may be battery operated, plug-in with Battery backup, hardwired with battery backup or a system.

**Carbon Monoxide Detectors shall not be further than 10 ft. from any bedroom entrance.**

Combination Detectors may be used: **WITHIN 20 ft** of a Kitchen or a Bath with a tub or shower shall be (a photoelectric smoke detector with carbon monoxide detector); **OUTSIDE of 20 ft** shall be (an ionization smoke with a carbon monoxide detector )

**Combination Detectors MUST BE Voice Annunciated.**

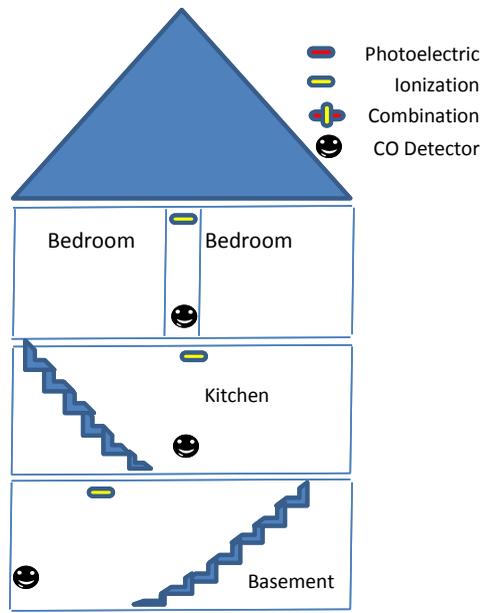

**HOUSES BUILT AFTER 1975 TO 1997**

\*Detectors are required on each habitable level.  
 \*At least one detector shall be located at the base of each stairway leading to the next level. The detector on the bedroom level shall be centrally located on the ceiling to cover each bedroom.

**There shall be a detector every 1200 sf of living space**

*\*For each level: if WITHIN 20 ft of Kitchen or or a Bath with a shower or tub, the smoke detector shall be Photoelectric.*

*\*For each level: if the detector is OUTSIDE of 20 ft. of a Kitchen or a Bath with a shower or tub, the smoke detector shall be a dual detector (both ionization and photoelectric ) OR two separate detectors (one photoelectric and one ionization).*


**DETECTORS**

**EVERY LEVEL MUST BE EQUIPED WITH CARBON MONOXIDE DETECTORS.** Carbon Monoxide Detectors may be battery operated, plug-in with Battery backup, hardwired with battery backup or a system.

**Carbon Monoxide Detectors shall not be further than 10 ft. from any bedroom entrance.**

Combination Detectors may be used (Photoelectric smoke and carbon monoxide detector) **anywhere.** Ionization with Carbon Monoxide detectors may be used outside of 20 ft from a Kitchen or Bath.

**Combination Detectors MUST BE Voice Annunciated.**

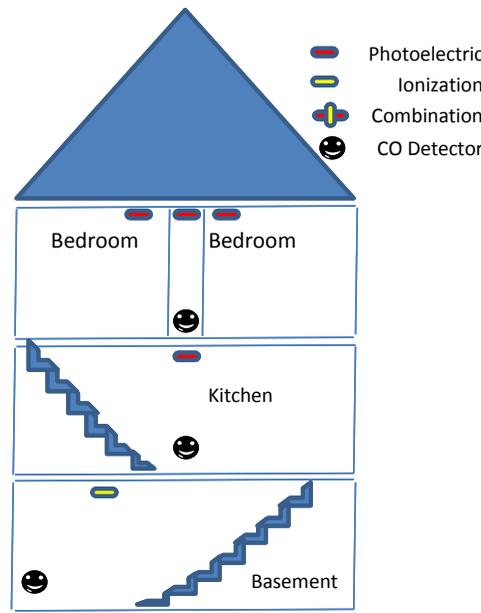

**HOUSES BUILT AFTER 1997 (6th ed.)**

\*Detectors are required on each habitable level.  
 \*At least one detector shall be located at the base of each stairway leading to the next level. The detector on the bedroom level shall be centrally located on the ceiling to cover each bedroom.

**There shall be a detector located in each bedroom.**

There shall be a detector every 1200 sf. Of living space.


If the smoke detector is within 20 feet of a Kitchen or a Bath with a tub or shower, the smoke detector is required to be a **Photoelectric Detector.**

**SMOKE DETECTORS SHALL BE HARDWIRED INTERCONNECTED W/BATTERY BACKUP.**

**EVERY LEVEL MUST BE EQUIPED WITH A CARBON MONOXIDE DETECTORS.** Carbon Monoxide Detectors may be battery operated, plug-in with Battery backup, hardwired with battery backup or a system. **Carbon Monoxide Detectors shall not be further than 10 ft. from any bedroom entrance.**

Combination Detectors may be used (Photoelectric smoke and carbon monoxide detector) **anywhere.** Ionization with Carbon Monoxide detectors may be used outside of 20 ft from a Kitchen or Bath.

**Combination Detectors MUST BE Voice Annunciated.**

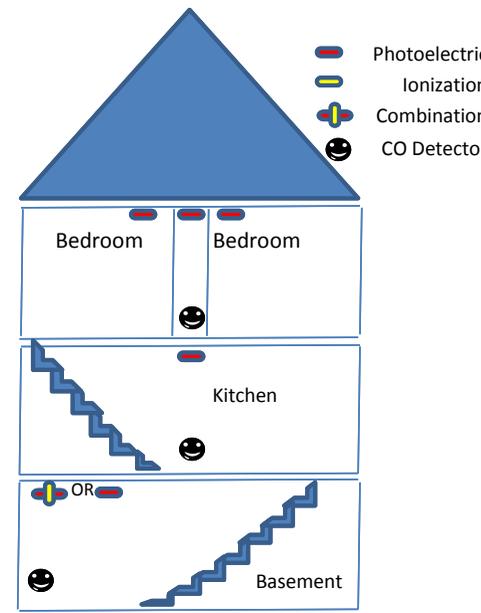

**HOUSES BUILT AFTER 2008 (7th ed.)**

\*Detectors are required on each habitable level.  
 \*At least one detector shall be located at the base of each stairway leading to the next level. The detector on the bedroom level shall be centrally located on the ceiling to cover each bedroom.

**There shall be a detector located in each bedroom.**

There shall be a detector every 1200 sf. Of living space.

*\*For each level: if WITHIN 20 ft of Kitchen or or a Bath with a shower or tub, the smoke detector shall be Photoelectric.*

*\*For each level: if the detector is OUTSIDE of 20 ft. of a Kitchen or a Bath with a shower or tub, the smoke detector shall be a photoelectric detector or a dual detector (containing both ionization and photoelectric technology).*

**EVERY LEVEL MUST BE EQUIPED WITH A CARBON MONOXIDE DETECTOR.**

Carbon Monoxide Detectors shall not be further than 10 ft. from any bedroom entrance.

Combination Detectors may be used (a photoelectric smoke detector and a carbon monoxide detector). Carbon Monoxide Detectors shall be hardwired interconnected with battery backup. (May be wired separately from the existing smoke detection system)

**Combination Detectors MUST BE Voice Annunciated.**

FUTURE USE

**HOUSES BUILT UNDER THE 8TH EDITION**

All Basement Detectors shall be **Photoelectric**.

All 1st floor detectors shall be **Photoelectric**.  
 All 2nd floor detectors shall be **Photoelectric**.

**ALL CARBON MONOXIDE DETECTORS SHALL BE HARDWIRED, INTERCONNECTED.**